
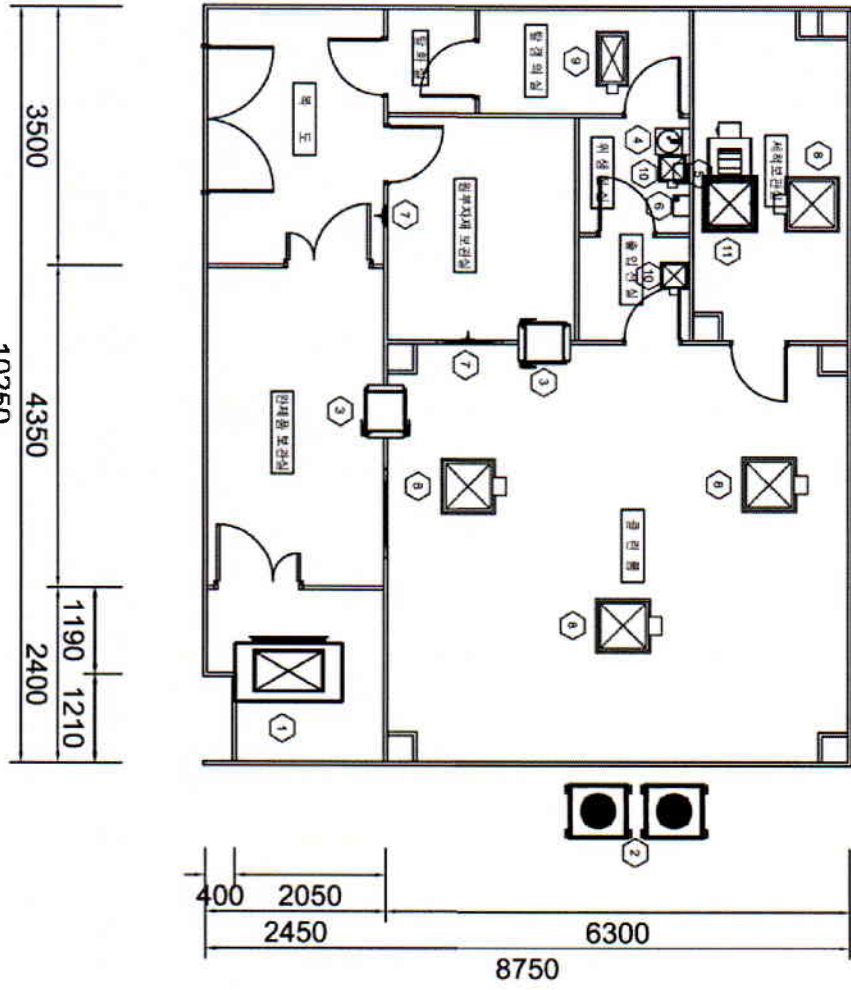
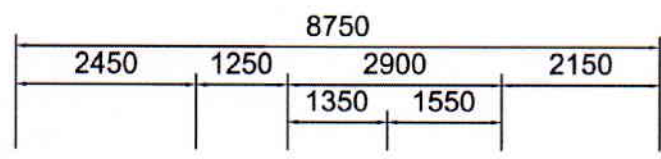


[illegible]

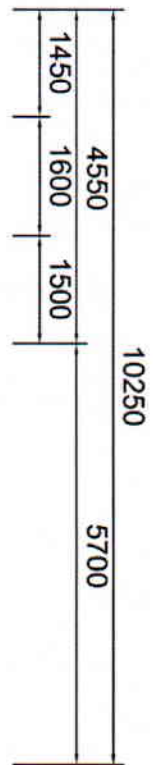


클린룸 장비 배치도
SCALE 1/70

11	BRU	STORER10K20Z	EA	1	
10	HEU-3	300X300X100	EA	2	
9	HEU-2	610X300X150	EA	1	
8	HEU-1	610X610X100	EA	4	
7	배기팬	0000	EA	1	
6	배기구		EA	1	
5	배기호		EA	1	배기호
4	배기호	STS	EA	1	
3	PASS BOX	600X600X900	EA	2	
2	CIN	S RT	EA	2	
1	ACU	BCCAK400000g	DET	1	
NO. DESCRIPTION SPECIFICATION MATL QTY REMARKS					
REVISION					
NO.	DATE	REV. DESCRIPTION	CHANGED BY	DATE	
1					
DRAWING TITLE					
클린룸 장비 배치도					
CLIENT APPROVAL					
DATE	DATE	DATE	DATE	DATE	
APPROVAL	DATE	DATE	DATE	DATE	
SCALE	1/70	DRAWING CODE	2015.01.01		
DRAWING NO.	M-11	SHEET NO.			
(주)대우건설 대우건설 (주)대우건설					
www.daeuconstruction.com TEL: 02-694-1000 FAX: 02-694-1002					

NOTE:

EPS 단위 판매 50T



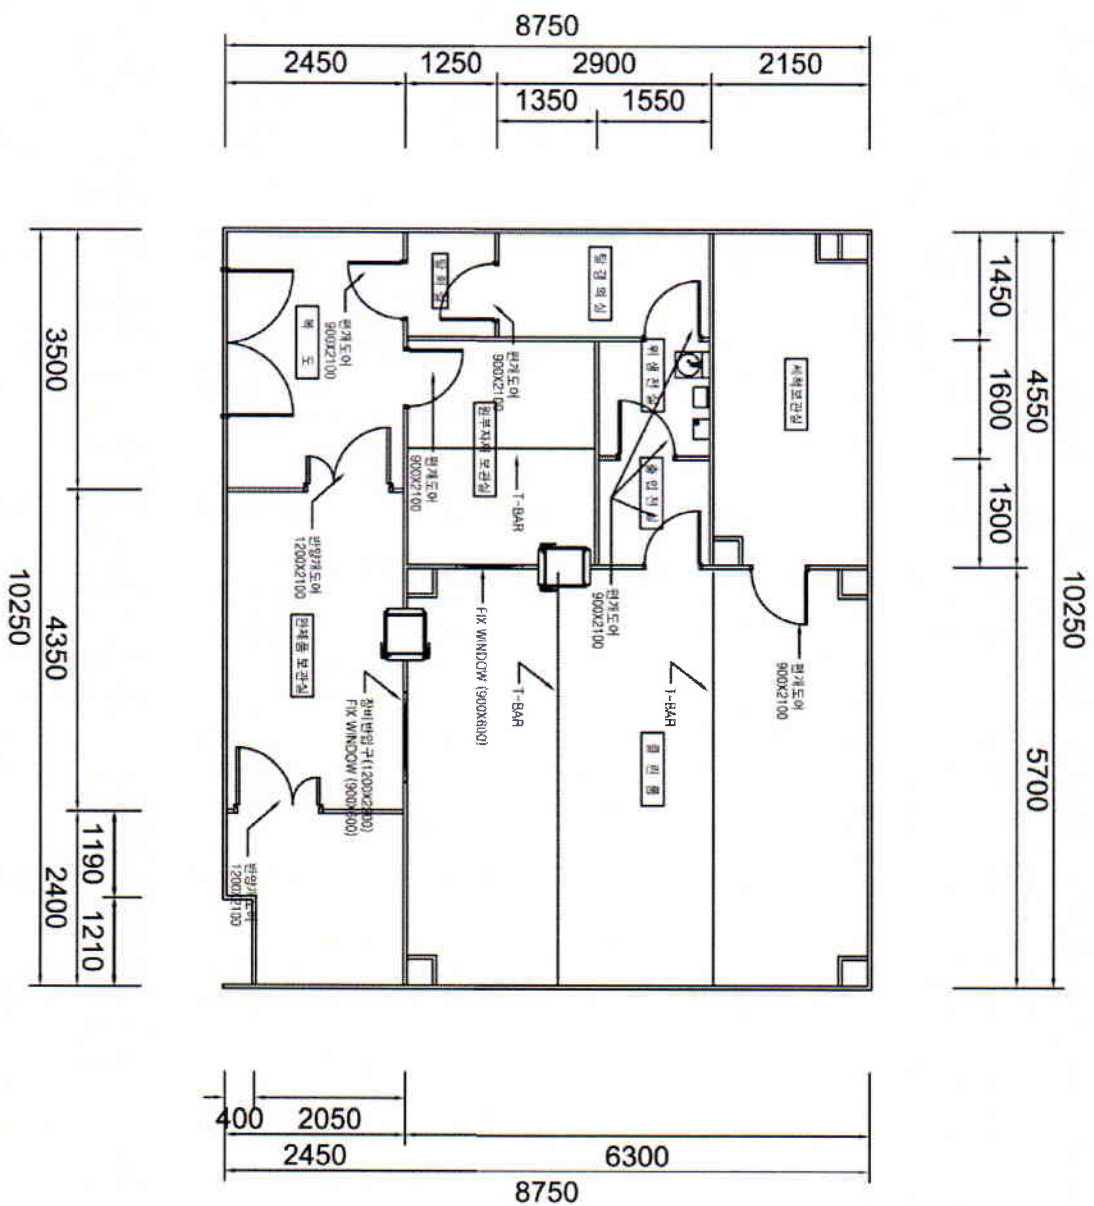


한글
한글
한글
한글
한글
한글

SCALE 1/70

[illegible]

[illegible]

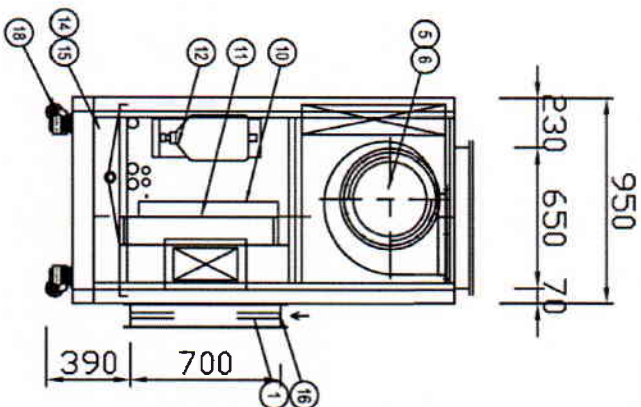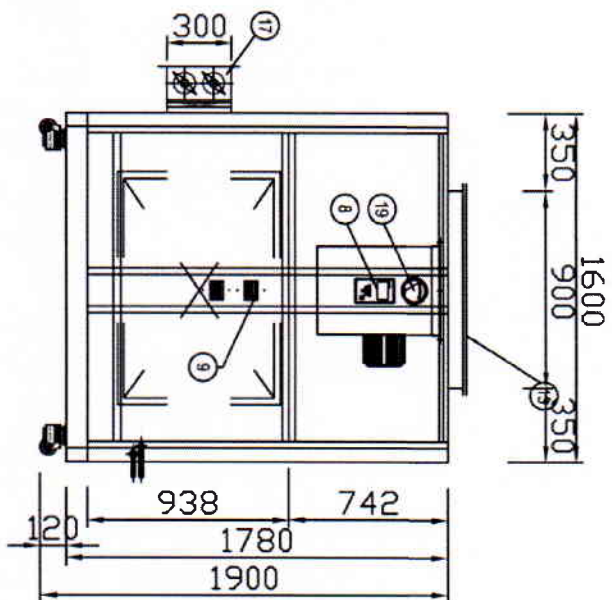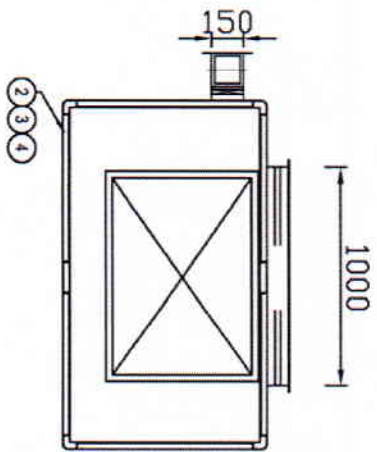

NO	NAME OF PART	MATERIAL	QTY	REMARKS
1	PRE FILTER	★외포	1	990x710x15t
2	CASING	SCP	1	1.2t
3	FRAME	SCP	1	1.6t
4	INSULATION	ATIRON	1	20t
5	SUPPLY FAN	SCP	1	SF # 20S DD
6	FAN MOTOR	ASS'Y	1	3KW x 6P
7	CONTROL PANEL	ASS'Y	1	
8	MONITOR	ASS'Y	1	시그널네스
9	DIGITAL PRESSURE	ASS'Y	2	HIGH, LOW
10	HEATING COIL	STS	1	20KW(SKW#4S)
11	COOLING COIL	AL+CU	1	1/2" #4R #22S #1250L
12	HUMIDIFIER	전치전기용	1	8 KG
13	SUPPLY FLANGE	SCP	1	900#650
14	DRAIN PAN	STS	1	1.2t/25A
15	BASE FRAME	SCP	1	1.6t
16	R.A FLANGE	AL	1	1000#700
17	D.A DAMPER	AL	1	300#150
18	FOOT MASTER		1	WT-100FP
19	차량개		1	차량개포스 3M, 0-50mmHg(8.28)

SPEC & UNITS	
MODEL NO.	BS-AUD-100
AIR VOLUME	9060 CMH/minAq
COOLING CAPACITY	26,000 Kcal/H
HEATING CAPACITY	17,200 Kcal/H
HUMIDITY CAPACITY	8 Kg/H
QTY	1

REMARK	
TYPE	3-280V/60HZ
DUCT TYPE	VIEW POINT
VIEW POINT	주요점(상하, 좌우)

AIR CONTROL UNIT DETAIL

SCALE: NONE

DRAWING TITLE		AIR CONT OR UNIT DETAIL	
CLIENT APPROVAL	DATE	CHECKED BY	DATE
APPROVAL	DATE	DRAWN BY	DATE
SCALE	NONE	CHECKED BY	DATE
DRAWING NO.	M-01	REVIEWED	DATE
(주)대우건설		CT	
100% INSULATION OF THE AIR UNIT TEL: 02-289-4400 FAX: 02-289-4400			